

DWG NO. 10211-0130

PAGE 1 OF 1

HAZARDOUS AREA


Class I, Groups A, B, C, D
 Class II, Groups E, F, G
WARNING: TO PREVENT IGNITION OF FLAMMABLE OR COMBUSTIBLE ATMOSPHERES, DISCONNECT POWER BEFORE SERVICING.

TRANSDUCER ENTITY PARAMETERS

WIRES	VMAX	IMAX	Ci	Li	Pi
Red - Black	28 V	93 mA	0.11 uF	0.22 mH	1.225W


USE THE FOLLOWING PARAMETERS IF CABLE PARAMETERS ARE UNKNOWN.
 CABLE CAPACITANCE: 60 pF/ft
 (EX. C_{cable}=1000ft x 60pF/ft=0.06 uF)
 CABLE INDUCTANCE: 0.2 uH/ft
 (EX. L_{cable}=1000ft x 0.2 uH/ft=0.2mH)

ALL INTRINSICALLY SAFE WIRING SHALL BE KEPT SEPARATE FROM NON-INTRINSICALLY SAFE WIRING. REFER TO ARTICLE 504 OF THE NATIONAL ELECTRICAL CODE

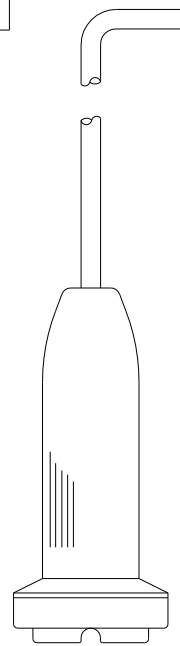

PRESSURE TRANSDUCER
SLX 130-MIS

SAFE AREA

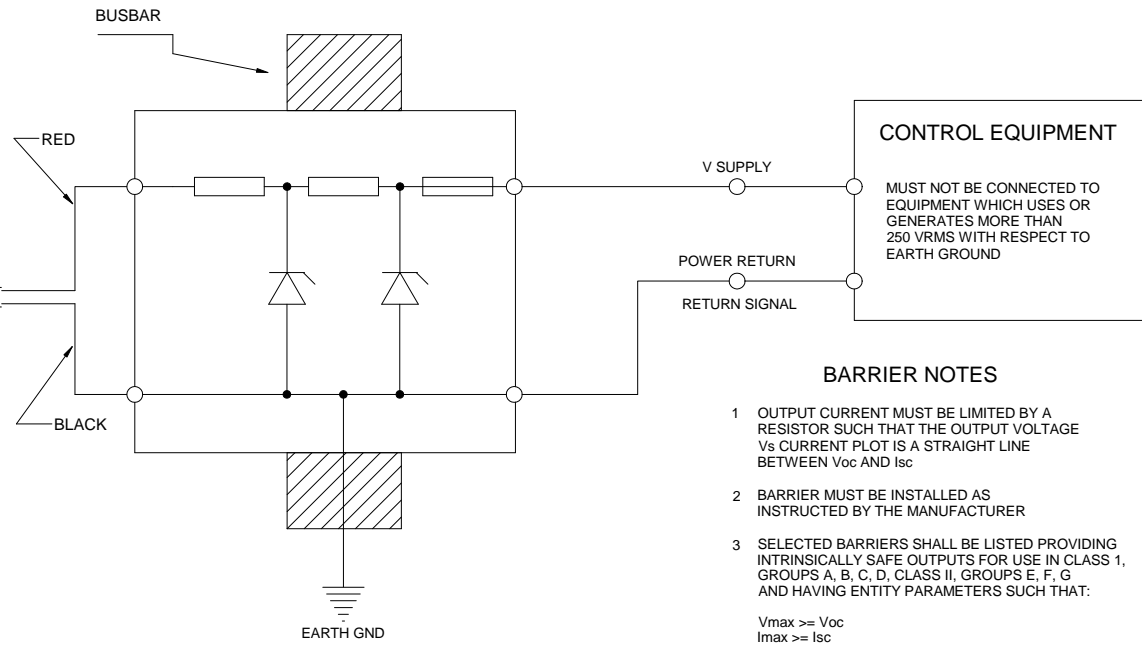

CONTROL EQUIPMENT
 MUST NOT BE CONNECTED TO EQUIPMENT WHICH USES OR GENERATES MORE THAN 250 VRMS WITH RESPECT TO EARTH GROUND

BARRIER NOTES

- OUTPUT CURRENT MUST BE LIMITED BY A RESISTOR SUCH THAT THE OUTPUT VOLTAGE Vs CURRENT PLOT IS A STRAIGHT LINE BETWEEN Voc AND Isc
- BARRIER MUST BE INSTALLED AS INSTRUCTED BY THE MANUFACTURER
- SELECTED BARRIERS SHALL BE LISTED PROVIDING INTRINSICALLY SAFE OUTPUTS FOR USE IN CLASS 1, GROUPS A, B, C, D, CLASS II, GROUPS E, F, G AND HAVING ENTITY PARAMETERS SUCH THAT:
 $V_{max} \geq V_{oc}$
 $I_{max} \geq I_{sc}$
 $P_i \geq P_o$
 $C_i + C_{cable} \leq C_a$
 $L_i + L_{cable} \leq L_a$
- TERMINATE BARRIER EARTH GROUND TO THE GROUND BUS OF THE POWER DISTRIBUTION PANEL. RESISTANCE TO GROUND MUST NOT BE GREATER THAN 1 OHM

Contegra Inc.
 1286 Carriage Hills, Eagan, MN 55123
 TEL:(651)905-0900 FAX:(651)454-4665 WEB: www.Contegra.com

REV	DATE	DESCRIPTION
01	1/19/04	RELEASED DWG by ES
02	7/28/04	added "4-20 mA" to title
03	8/19/04	Text edits per UL Remove "PB" note
04	8/23/04	Text edits per UL
05	5/13/08	Edits per manufacturing

TITLE **SLX 130-MIS 4-20 mA OUTPUT SYSTEM DIAGRAM for UL 913 INTRINSIC SAFETY CERTIFICATION**

SIZE A	DWG. NO. 10211-0130	REV. 05
SCALE:	DO NOT SCALE PRINT	PAGE 1 OF 1